



PRESENTATION

BY CAPTAIN STEVE ROWLAND



FIRE AND FIRE SAFETY

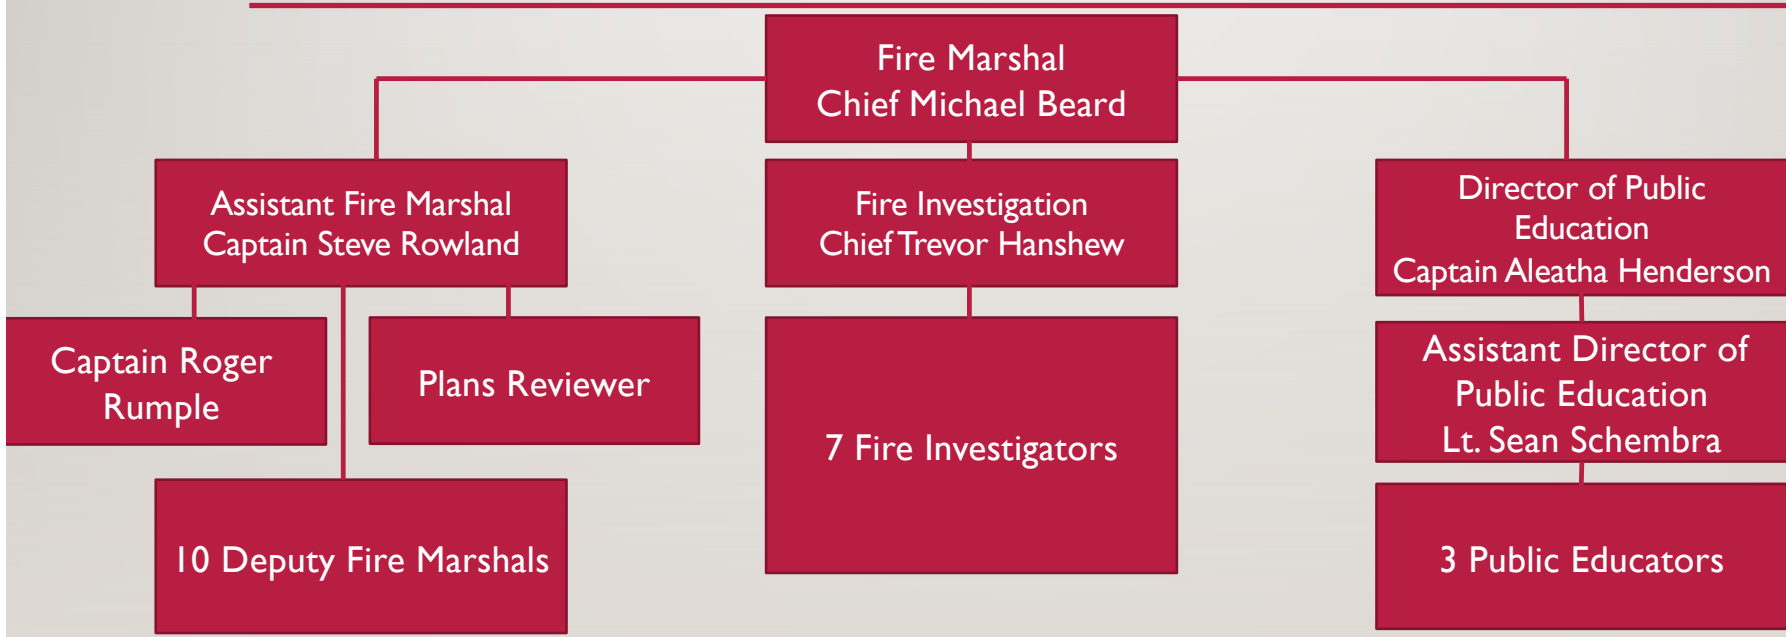

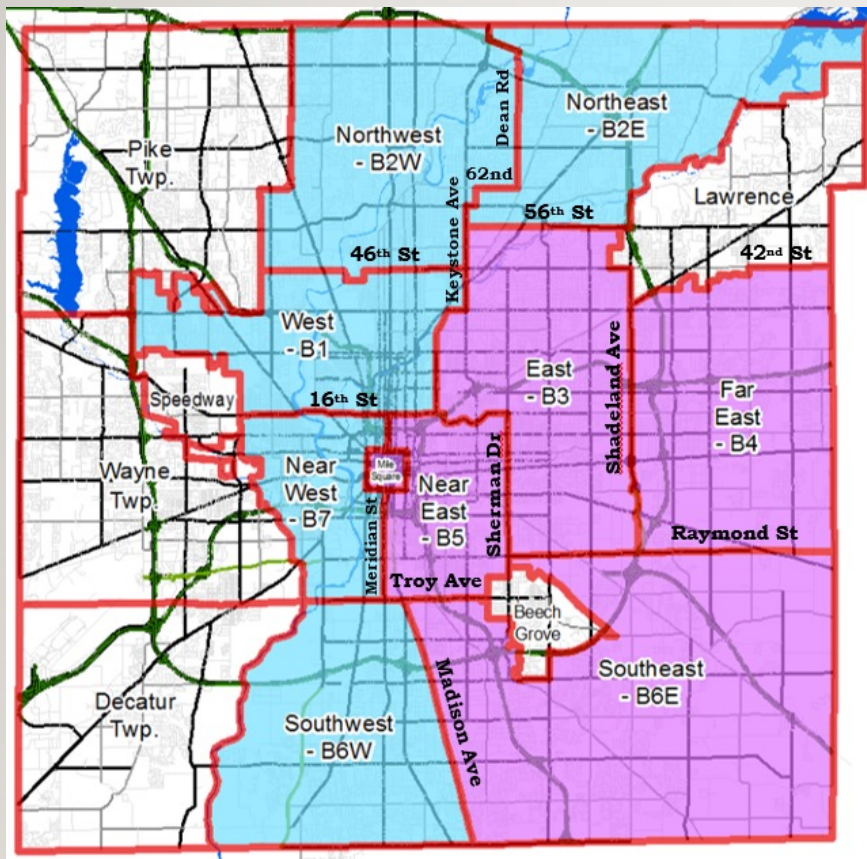

Margie Bovard Car-117 317-716-8306 Plan Reviewer

- MS Open
- B1 Janice White Car-129 317-935-4691
- B2E Bobby Baker Car-126 317-935-4687
- B2W Open
- B3 Tim Smith Car-121 317-935-4681
- B4 David Carpenter Car-123 317-935-4683
- B5 Tim Gallagher Car-122 317-935-4682
- B6W Jordan Perryman – 127 317-935-4715
- B6E Tony Lantz Car-120 317-935-4674
- B7 Tosha Lumbreras Car-124 317-437-8436

- New Deputy Fire Marshal
- Rob Lee – Car 128 317-801-3707
- Kevin Gibson – Car 125 317-935-4705



INSPECTION TYPES

- **Deputy Fire Marshal** **Moderate to High Risk Occupants / Buildings**
 - **Group A – U**
 - **Common Area / Building Shell**
 - **Final Inspection**
- **Company Inspection** **Low to Moderate Risk Occupants / Buildings**
- **Private Inspection** **Low to Moderate Risk Occupants / Buildings**
- **Self-Inspection** **Low Risk Occupants**

CONTRACTORS PORTAL



Effective Monday, January, 5, 2015, the Indianapolis Fire Department (IFD) will require all Fire Protection Equipment Companies (contractors) that service and/or maintain Fire Protection Systems to submit their reports via an IFD approved electronic reporting system. Please note that any other type of submission of reports will NOT be accepted. In other words, AS A BUSINESS OWNER, it is ultimately your responsibility to ensure proper and timely filing of all inspection reports.

CONTRACTORS PORTAL



Therefore, we urge you to please check with your service providers/contractors to ensure they too are in compliance with this new process. Further, if inspection reports are not filed appropriately and/or timely, IFD will automatically assume that services have not been rendered and take the necessary actions to ensure safety and compliance.

CONTRACTORS PORTAL



- **Passed**—No action required. A Deputy Fire Marshal (DFM) will visit annually to conduct an inspection of the said business.
- **Non-Critical Deficiencies**--A DFM will contact the business to remedy deficiencies and to ensure safety and compliance.
- **Critical Deficiencies**—A DFM will contact the business to remedy deficiencies and to ensure safety and compliance.
- **Impairments**—A DFM will visit the business to immediately remedy the impairment in order to avoid fire watch or evacuation per state law.

CONTRACTORS PORTAL



Address:

Contact:

Contractor:

Critical

Review Inspection

From Contractor Access Portal - submitted (local time): 4/1/2022 10:18:42 AM

Address:

Contact:

Contractor:

Non Critical

Review Inspection

From Contractor Access Portal - submitted (local time): 4/1/2022 10:00:56 AM

Address:


Contact:

Contractor:

None

Review Inspection

From Contractor Access Portal - submitted (local time): 4/1/2022 12:26:46 PM

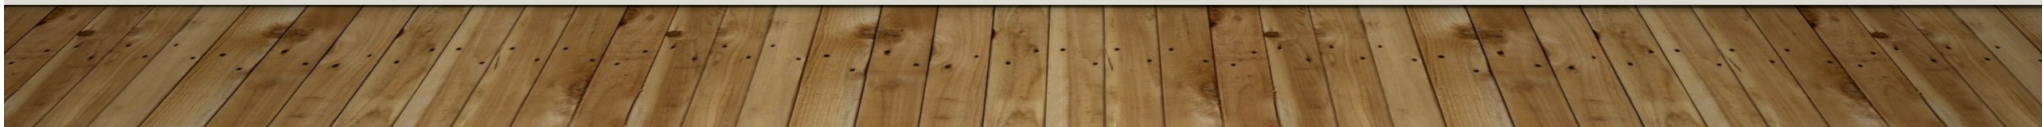

CONTRACTORS PORTAL



Address selected from existing data.

Address:
Street:
City:
State:
Zip: 46219

Contact

Contact selected from existing data.

Business Name:
First Name:
Last Name:
Phone:
Cell Phone:
Role/Job Desc:
E-mail:

Occupant


Occupant selected from existing data.

Building/Structure:
Occupant:
Occupancy Number:
Suite:
Commercial/Residential: Commercial

Defects

Hood Suppression System (Semi-annual)
-none-

Uploaded Files

File Name	Upload Date
 20220401242644_ <input type="text"/>	4/1/2022 12:26:44 PM

SYSTEM IMPAIRMENTS - TYPES



- No power to the Fire Alarm System (All or Part)
- Fire Alarm Panel Not Communicating.
- Multiple False Alarms
- Silencing a Fire Alarm for an Event or Over Occupancy
- Impairment to Fire Pump
- No Water to Wet Sprinkler System (All or Part)
- Extended Preplanned Impairments (Fire Alarm, Fire Pump, and Sprinkler)

CODES AND STANDARDS



- **Indiana Fire Code 2014, Section 901.7 - System out of Service**
- Where a required fire protection system is out of service, the fire department and the code official shall be notified immediately and the building shall either be evacuated or an approved fire watch shall be provided for all occupants left unprotected by the shut down until the fire protection system has been returned to service. Where utilized, fire watches shall be provided with at least one approved means for notification of the fire department and their only duty shall be to perform constant patrols of the protected premises and keep watch for fires. 675 IAC 22-2.5



CODES AND STANDARDS

- **Indiana Fire Code 2014, Section 403.1 - Fire Watch Personnel**
- Whenever, it is essential for the public safety in any Class 1 structure or any other place where people congregate, due to the number of persons, or the nature of the activity being conducted, the fire chief may require the owner, agent or lessee to employ one (1) or more qualified persons, to be approved by the fire chief, to be on duty in such Class 1 structure to serve as a fire watch. Such persons shall:
 - Be subject to the fire Chief's orders at all times;
 - Be in uniform; and
 - Remain on duty at all times that such Class 1 structure is open to the public.
 - Such persons shall not be required or permitted, while on duty, to perform any duties other than the fire watch. 675 IAC 22-2.5
 - (Fire watch pay rate shall be \$40.00 an hour)

CODES AND STANDARDS




- **Indiana Fire Code 2014, Section 403.1.1 - Duties**
- Fire watch personnel shall keep diligent watch for fires, obstructions to means of egress and other hazards during the time such place is open to the public or such activity is being conducted and take prompt measures for remediation of hazards, extinguishment of fires that occur and assist in the evacuation of the public from the structures.

CODES AND STANDARDS



- **Indiana Fire Code 2014, Section 403.1.2 – Qualified Person**
- For the purposes of Section 403, qualified person means a person who has been trained to meet and be capable of carrying out the duties and requirements listed in Section 403.1.1 and is acceptable to the fire chief over the jurisdiction wherein the fire watch is taking place. 675 IAC 22-2.5



LOCK BOX

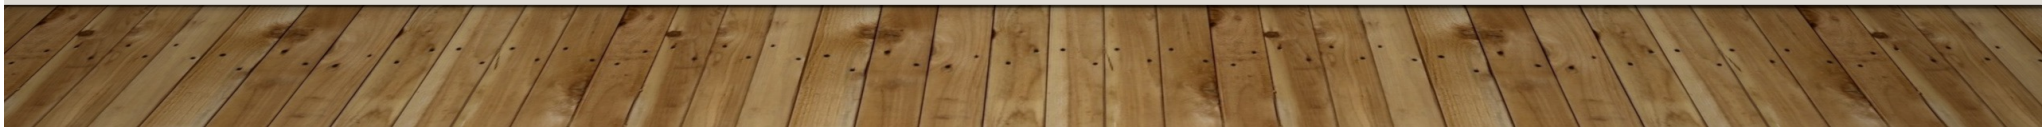


LOCK BOX



FDC ISSUES

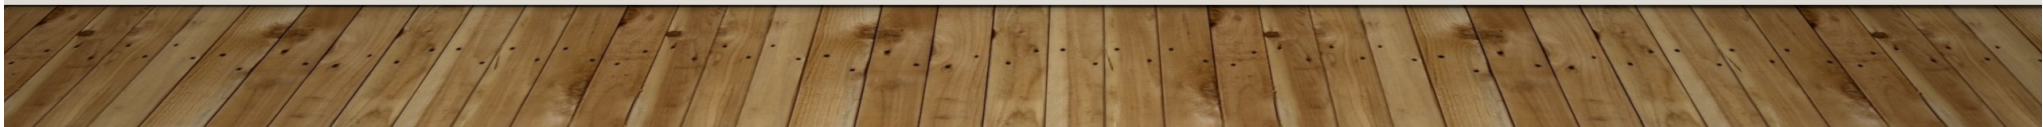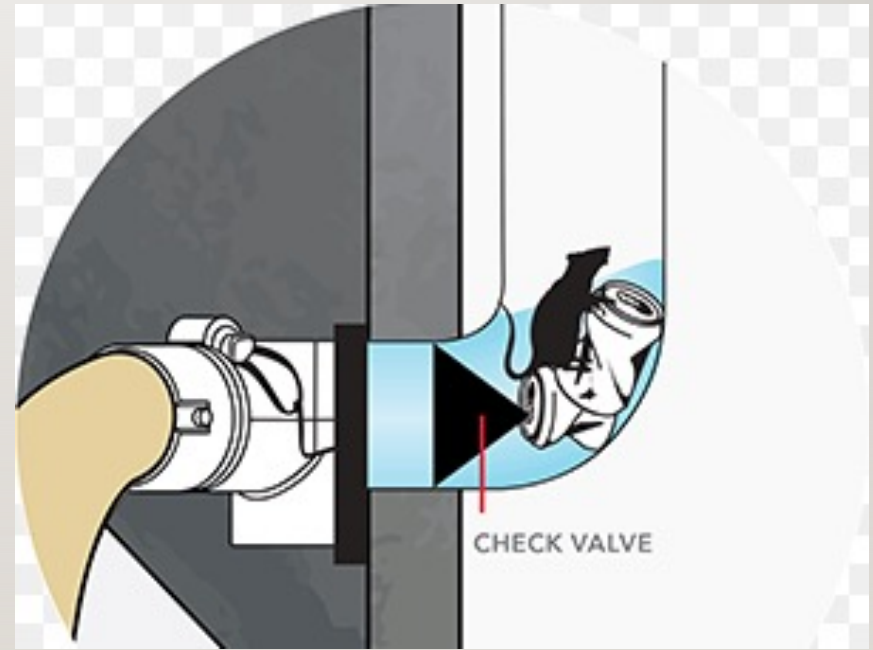

LOCKING CAPS - SIGNAGE

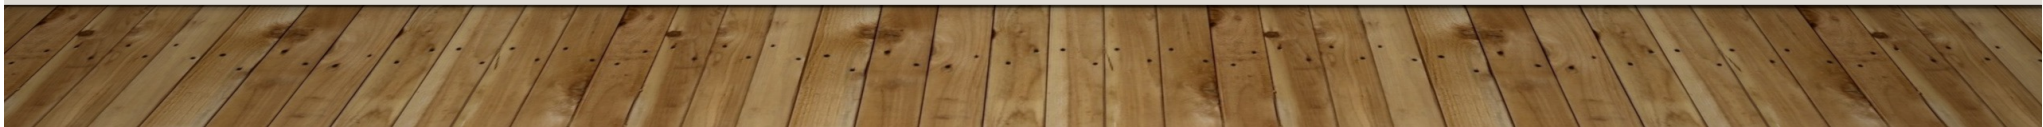

RESOURCES AVAILABLE



- **Observer Fire Drills**
- **Review Emergency Action Plans**
- **IFD Plans Reviewer will meet with Contractors and Architect over new construction project in your building.**
- **Public Education Programs**
 - **Workplace Intervention Safety Education**


IFD EVENTS 2022



Firefighter for a Day Camp - June 22nd – 25th

Safety Festival (MCPHD) - July 30th

IFD Showcase Festival - September 10th

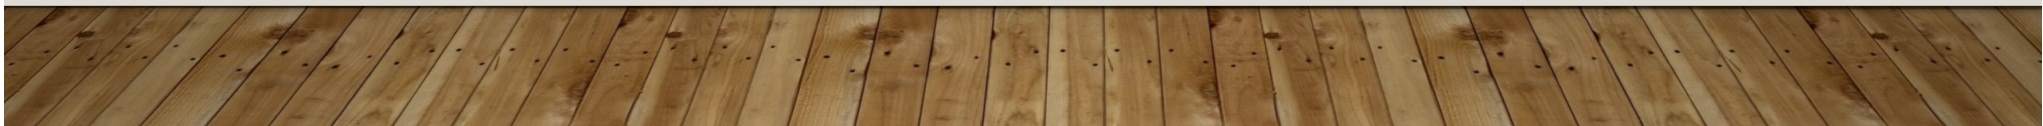

THANK YOU

- To schedule a Fire W.I.S.E presentation - www.indy.gov/IFD or 317-327-6706

