





Focus On Change 2026

Southwest District Wastewater Update



Overview

- SSO Reporting Requirements
- Using Map Direct
- Common Deficiencies
- Southwest District Wastewater Contacts
- Questions?





SSO Reporting

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

- **SSOs must be reported in accordance with F.A.C. Rule 62-604.550 & 62-620.610**
- SSOs < 1,000 gallons MUST be reported to the Department within 24 hours from the time the owner/operator becomes aware
- SSOs > 1,000 gallons or may endanger health or the environment MUST be reported to the State Watch Office no later than 24 hours from the time the owner/operator becomes aware
 - If reporting to SWO is required, a Public Notice of Pollution (PNP) can be submitted via Business Portal submission, or can be submitted on the PNP webpage, or through email or call to DEP
 - <http://floridadep.gov/pollutionnotice>



Information for SSO Reporting

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

- Name, address, and telephone number of person reporting,
- Name, address, and telephone number of permittee or responsible person for the discharge,
- Date and time of the discharge and status of discharge (ongoing or ceased),
- Characteristics of the wastewater spilled or released (untreated, partially treated, treated, industrial or domestic wastewater),
- Estimated amount of the discharge,
- Location or address of the discharge,
- Source and cause of the discharge,
- Whether the discharge was contained on-site, and cleanup actions taken to date,
- Description of area affected by the discharge, including name of water body affected, if any; and,



SSO DEP Portal

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

- DEP Business Portal
 - <https://www.fldepportal.com/DepPortal/go/home>
- SSOs are entered directly by responsible entity to ensure accurate spill information
- Reduces time spent on multi-agency notifications
- Notifies District office, populates Public Notice of Pollution and notifies DOH if within one mile of healthy beaches monitoring location
- Auto-populates nearby water bodies, if needed for report
- Auto-reminder email to finish report if not completed within five days



florida dep map direct



AI Mode All Images Maps Videos News Short videos More options

Tools



Florida Department of Environmental Protection (.gov)

https://ca.dep.state.fl.us › mapdirect



Map Direct Gallery



Open **Map Direct** · Create and share your own maps from thousands of available data layers provided by dozens of agencies including **DEP**. · **Map Direct Quick Start** ...

Standard Map

... browser does not support JavaScript. This web map ...



Dep map direct

... browser does not support JavaScript. This web map ...



Map Direct v7

Loading Map Direct + + - - Reading Map Configuration...



FDEP Open Data





SEARCH DEP WEBSITE...



[Open Map Direct](#)

Create and share your own maps from thousands of available data layers provided by dozens of agencies including DEP.

- [Map Direct Quick Start Documents](#)
- [YouTube Tutorial Series](#)

Map Direct Gallery

Click the images below to open the maps, or select them from the drop down list.

Division of Air Resource Management (DARM)

[^ Top ^](#)






More Data...



Add Layers



drag corner thumb to resize [\[close\]](#)



Tool Bar Access



Choice of Map

Show Imagery Slider



1:9,244,648



Imagery with Roads



Topographic



USA Topo Maps



National Geographic



OpenStreetMap



Streets



Terrain with Labels



Light Gray Canvas



Dark Gray Canvas



Oceans



Imagery

8203

7759" x -88°39'2



Commonly used layers for Domestic Wastewater

- Wastewater Facility Regulation (WAFR) -
Wastewater Facilities
- Wastewater Facility Regulation (WAFR) -
Residual Application
- Wastewater Facility Regulation (WAFR) -
Wastewater Sites
- Waterbody IDs (WBIDs)



City of Wauchula



4 Items Available.

[Need Help Searching?](#)

Show Only Items From Florida Department of Environmental Protection

All Content Types

1/9 by Relevance to Search Criteria

Compact View

Page 1/1 Items 1 - 9 of 9 *Not finding what you are looking for?* [Widen Filter](#)



Wastewater Facility Regulation (WAFR) Map

[Back to Top](#)

Web Map Shared by FDEPMapDirect :: Florida Department of Environmental Protection

[More Information](#)

Add **Layers** to Map

Open as New Map



Wastewater Facility Regulation (WAFR) - Wastewater Sites

[Back to Top](#)

Feature Layer Shared by FDEPOpenDataPortal :: Florida Department of Environmental Protection
12479 Locations | 35 Attributes

[More Information](#)

Download as: [Shapefile](#) | [CSV Spreadsheet](#) | [KML](#) | [GeoJSON](#)

Add Layer to Map



Wastewater Facility Regulation (WAFR) - Wastewater Facilities

[Back to Top](#)

Feature Layer Shared by FDEPOpenDataPortal :: Florida Department of Environmental Protection
2759 Locations | 36 Attributes

[More Information](#)

Download as: [Shapefile](#) | [CSV Spreadsheet](#) | [KML](#) | [GeoJSON](#)

Add Layer to Map



More Data...



Wastewater Facility Regulation (WAFR) - Residual Application



Wastewater Facility Regulation (WAFR) - Wastewater Sites




Wastewater Facility Regulation (WAFR) - Wastewater Facilities



Waterbody IDs (WBIDs)

Show Imagery Slider




1:577,790



← drag corner thumb to resize [close]

Map Direct: Standard Map

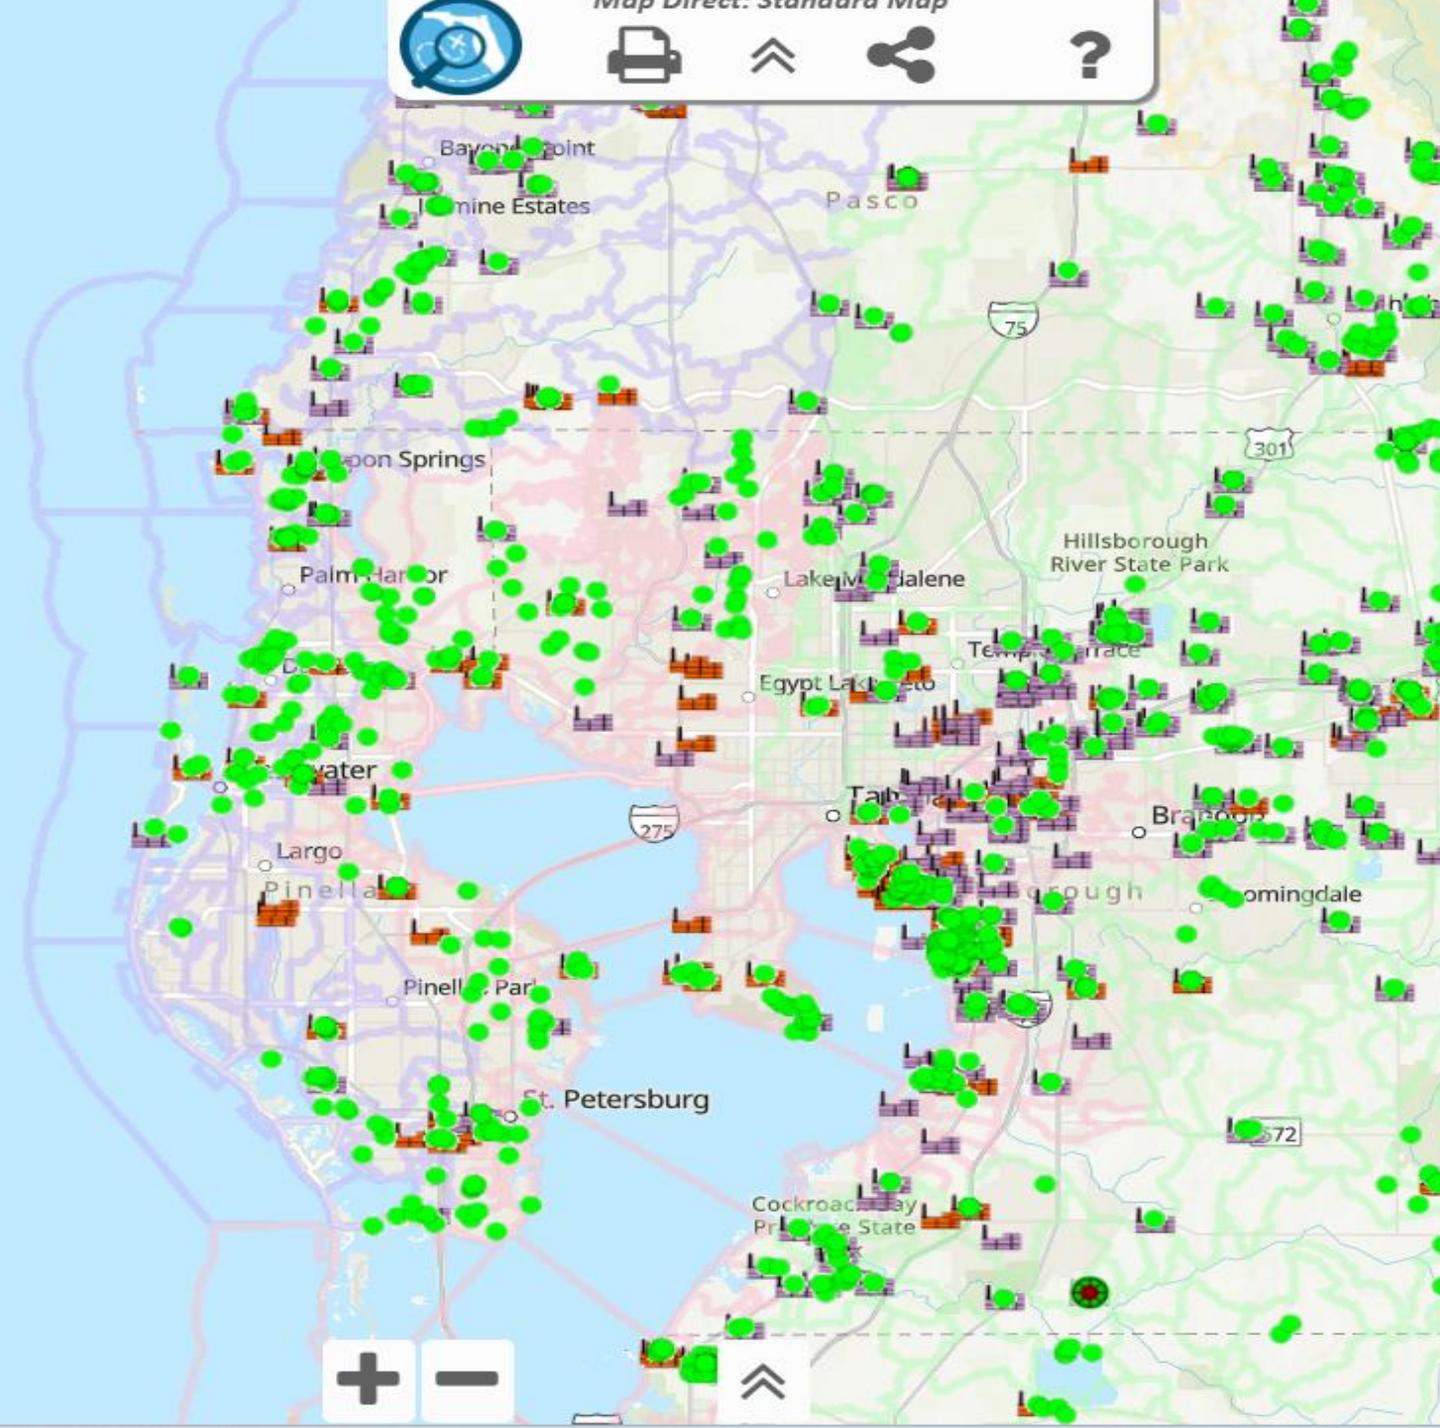




Wastewater Facility Regulation (WAFR) - Wastewater Sites

Permitted AFO and CAFO Facilities

NPDES Surface Water Discharge

Non-Surface Water Discharge

Waterbody IDs (WBIDs)

Group 1

Group 2

Group 3

Wastewater Facility Regulation (WAFR) - Residual Application Sites - Residual Application Sites from WAFR IMS

Wastewater Facility Regulation (WAFR) - Wastewater Sites

Wastewater Facility Regulation (WAFR) - Wastewater Facilities - Wastewater Facilities from WAFR IMS

NPDES Surface Water

Show Imagery Slider

Non-Surface Water Discharge


Waterbody IDs (WBIDs)

Group 1

1:577,790



Map Direct: Standard Map

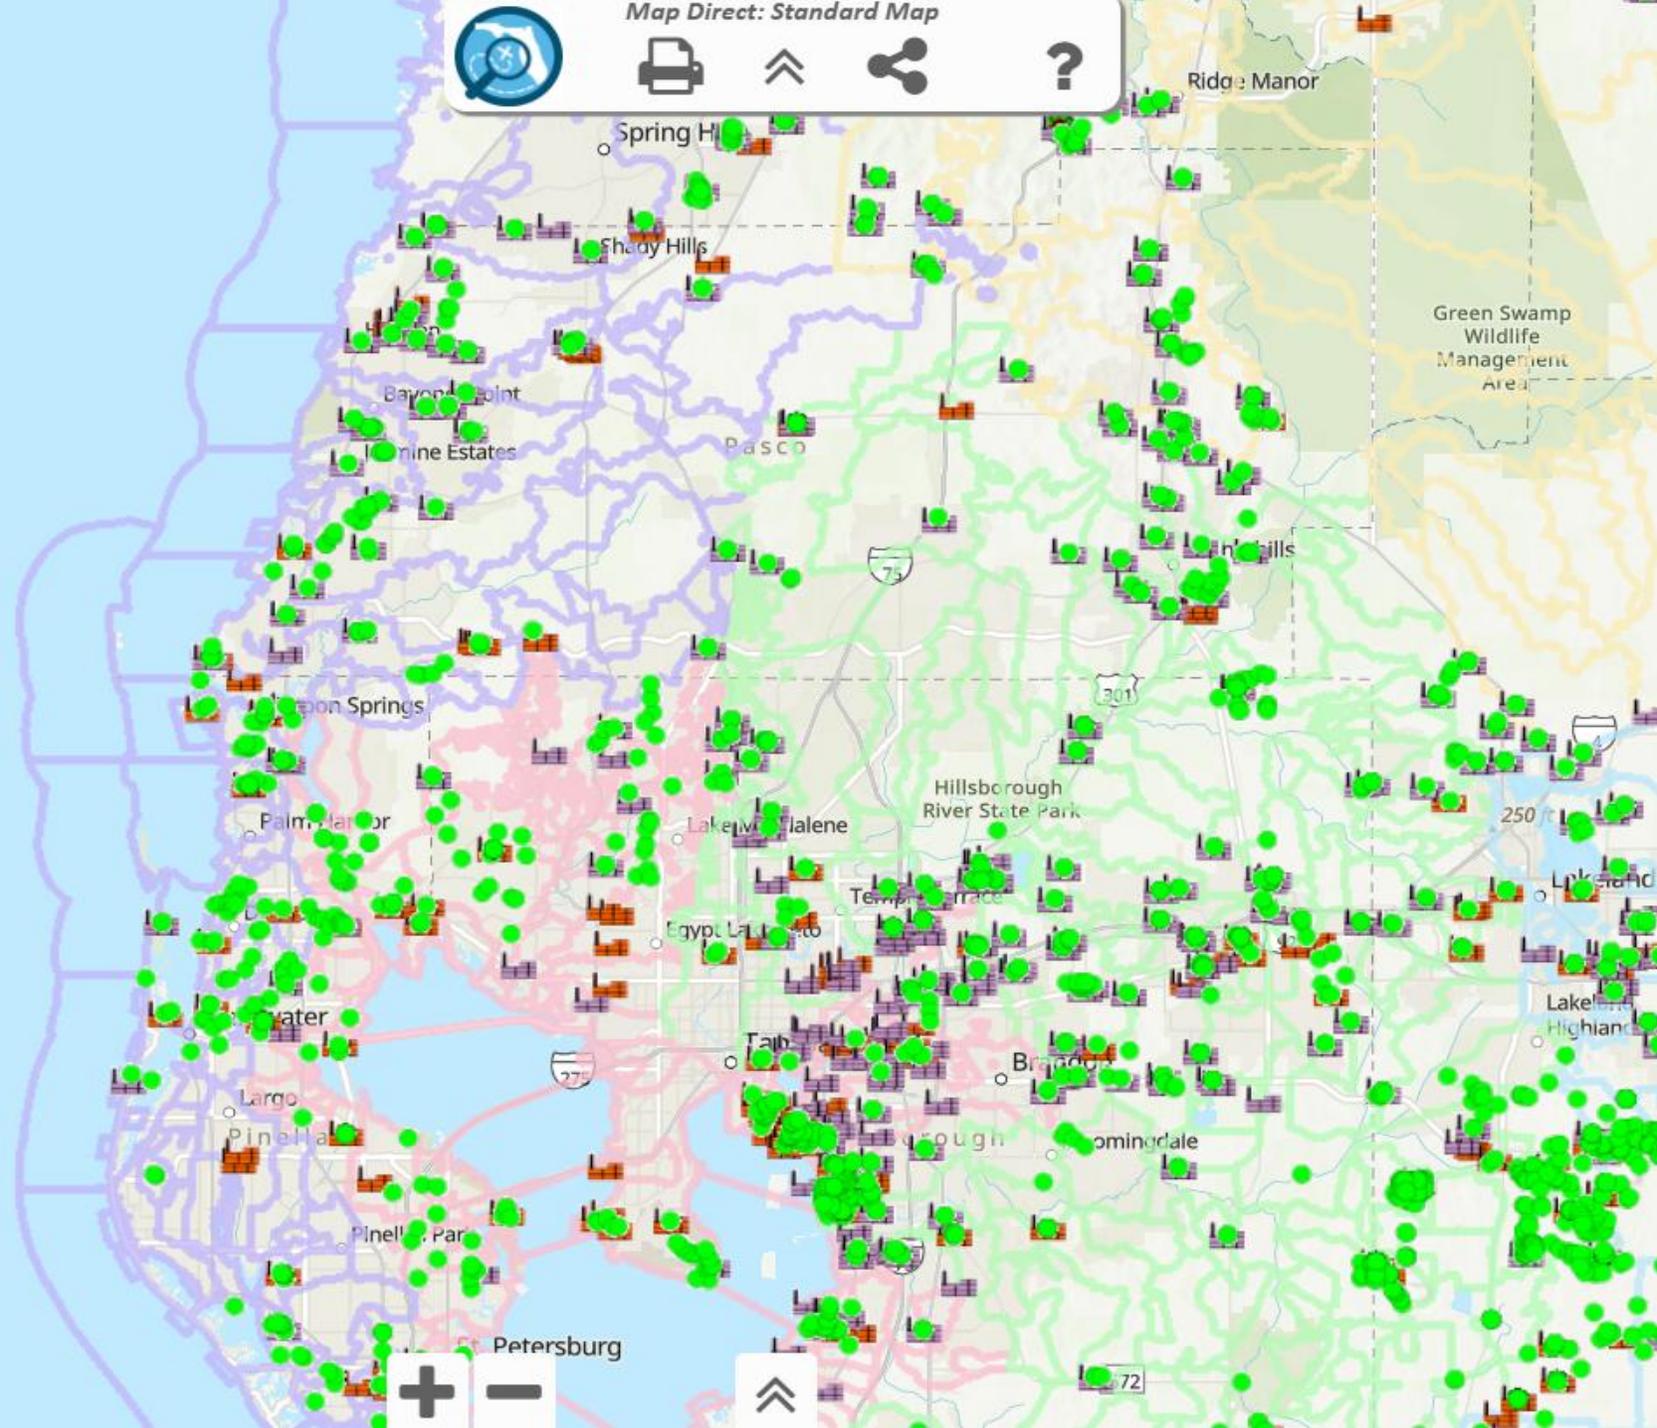

72



Map Direct: Standard Map



fl01274



Florida Way
Forest Dr
Sea Forest Dr

n St

Main St

Main St

Main St

Main St

Main St

Main St

Arnesen Ct

Treasure Dr

Fiscal Dr

New Port Richey City Of WWTF
FACILITY NAME

13454
LOCATIONAL ID

12743
WAFR FACILITY ID

FL0127434
FACILITY ID

<https://prodenv.dep.state.fl.us/DepNexus/pu...documents/FL0127434/gis-facility!searchDOCUMENTS>

(51) Pasco County
COUNTY

Pasco County
COUNTY NAME

(Southwest District) Southwest District
OFFICE NAME

(SWD) Southwest Regulatory District
DISTRICT NAME

Y
NPDES

N
PRETREAT REQ

DPHO
CMCD COORDINATE METHOD ID

Domestic Wastewater Program
ENVIRONMENTAL INTEREST

A
FACILITY STATUS

DW
FACILITY TYPE

Wastewater Facility
MANAGED ENTITY TYPE



28.24754718 x -82.73725242
28°14'51.1698" x -82°44'14.1087"



--Show County--



DEP Facility/Site Details and Associated Documents

Facility/Site Details

Facility/Site ID = FL0127434
 Facility/Site Name = NEW PORT RICHEY CITY OF WWTF
 Address = 4730 Main St
 City = NEW PORT RICHEY
 County = PASCO
 District = SWD

For more information regarding this facility, navigate to the following DEP webpage and identify your district contact: <http://www.dep.state.fl.us/secretary/dist/>

Records on this page = 50 of 806

Your search returned these documents available online from DEP's unrestricted EDMS catalogs:

Click on the **View** link below to open a specific document.

[Export CSV Data](#)


Document Date	Document Type and Subject	File Type and Size	View
07/22/2025	INCIDENT OR MALFUNCTION REPORTING RELATED ABNORMAL EVENT SSO; 13,000 GALLONS; 4210 SWEETBRIAR DR, HOLIDAY; MEMO	.pdf - 410.7 KB	▶
07/21/2025	INCIDENT OR MALFUNCTION REPORTING RELATED ABNORMAL EVENT SSO; 300 GALLONS; 13TH AVENUE, NEW PORT RICHEY; MEMO	.pdf - 238.8 KB	▶
07/09/2025	INCIDENT OR MALFUNCTION REPORTING RELATED ABNORMAL EVENT SSO; 5 GALLONS; 3198 MELA CT, HOLIDAY; MEMO	.pdf - 239.0 KB	▶
07/01/2025	INCIDENT OR MALFUNCTION REPORTING RELATED ABNORMAL EVENT SSO; 500 GALLONS; 3503 GREEN KEY RD, NEW PORT RICHEY; MEMO	.pdf - 239.3 KB	▶
06/26/2025	INCIDENT OR MALFUNCTION REPORTING RELATED ABNORMAL EVENT SSO; 3,000 GALLONS; 1410 SWEETBRIAR DR, HOLIDAY; MEMO	.pdf - 465.1 KB	▶
06/03/2025	CLEARANCE RELATED CS51-0029472-122-DWC/CM - AQUASONIC CAR WASH - NEW PORT RICHEY - FINAL CLEARANCE LETTER	.pdf - 430.6 KB	▶
06/02/2025	CLEARANCE RELATED NOTIFICATION RECEIPT FOR FINAL CLEARANCE OF AQUASONIC CAR WASH - NEW PORT RICHEY 0029472-122-DWC/CM	.pdf - 37.6 KB	▶



If an unauthorized discharge has reached a surface waterbody, regulated facilities can reference Rule 62-302.530 Florida Administrative Code for water quality criteria.


**3M – Class III Marine Waterbody
Sample for Enterococci**

**3F – Class III Fresh Waterbody
Sample for E. Coli**

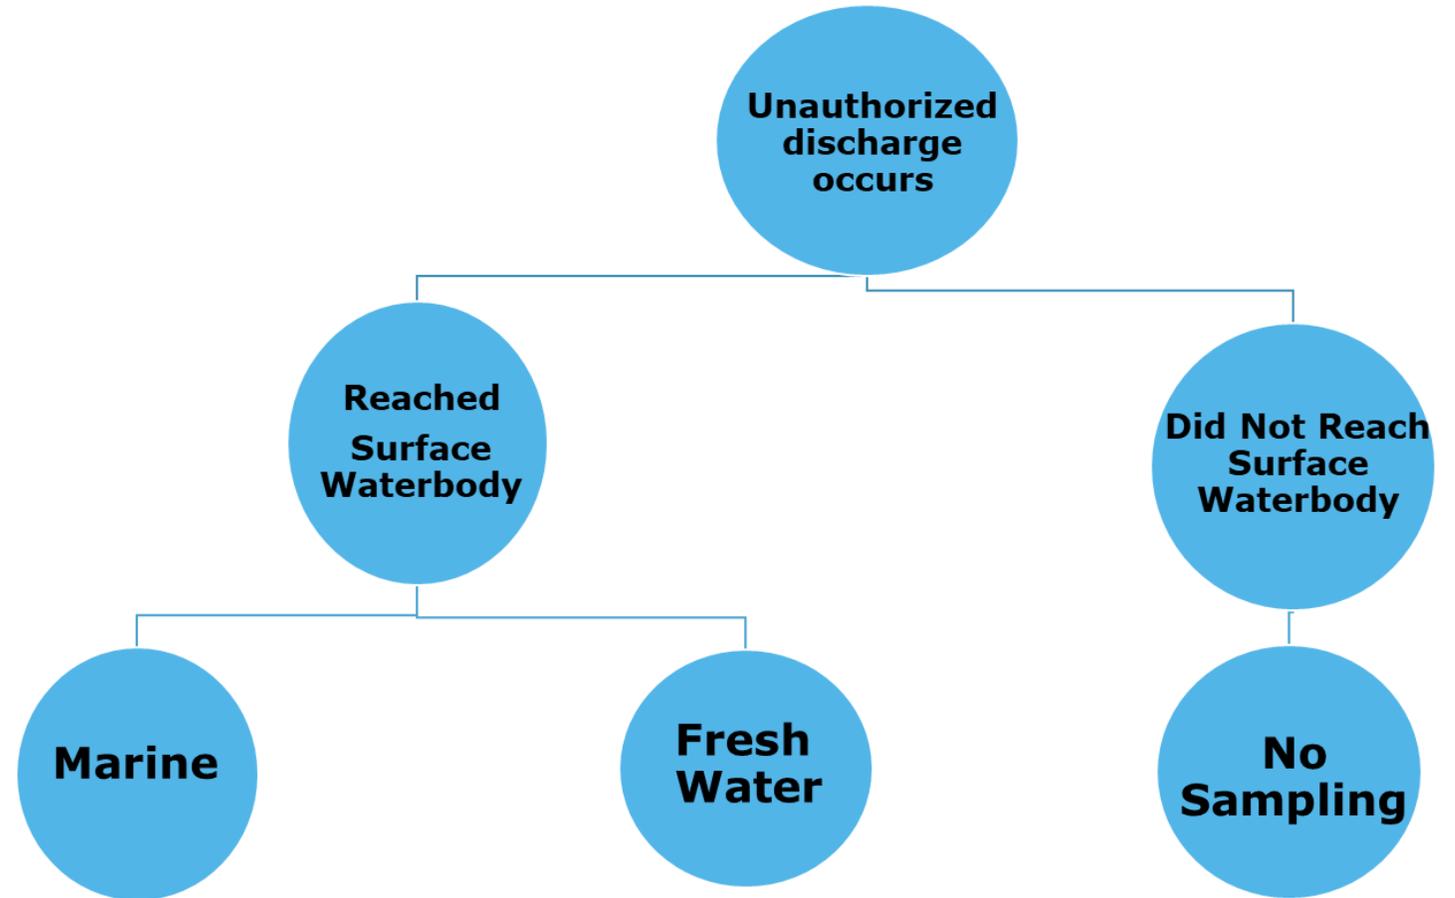



Map Direct: Standard Map

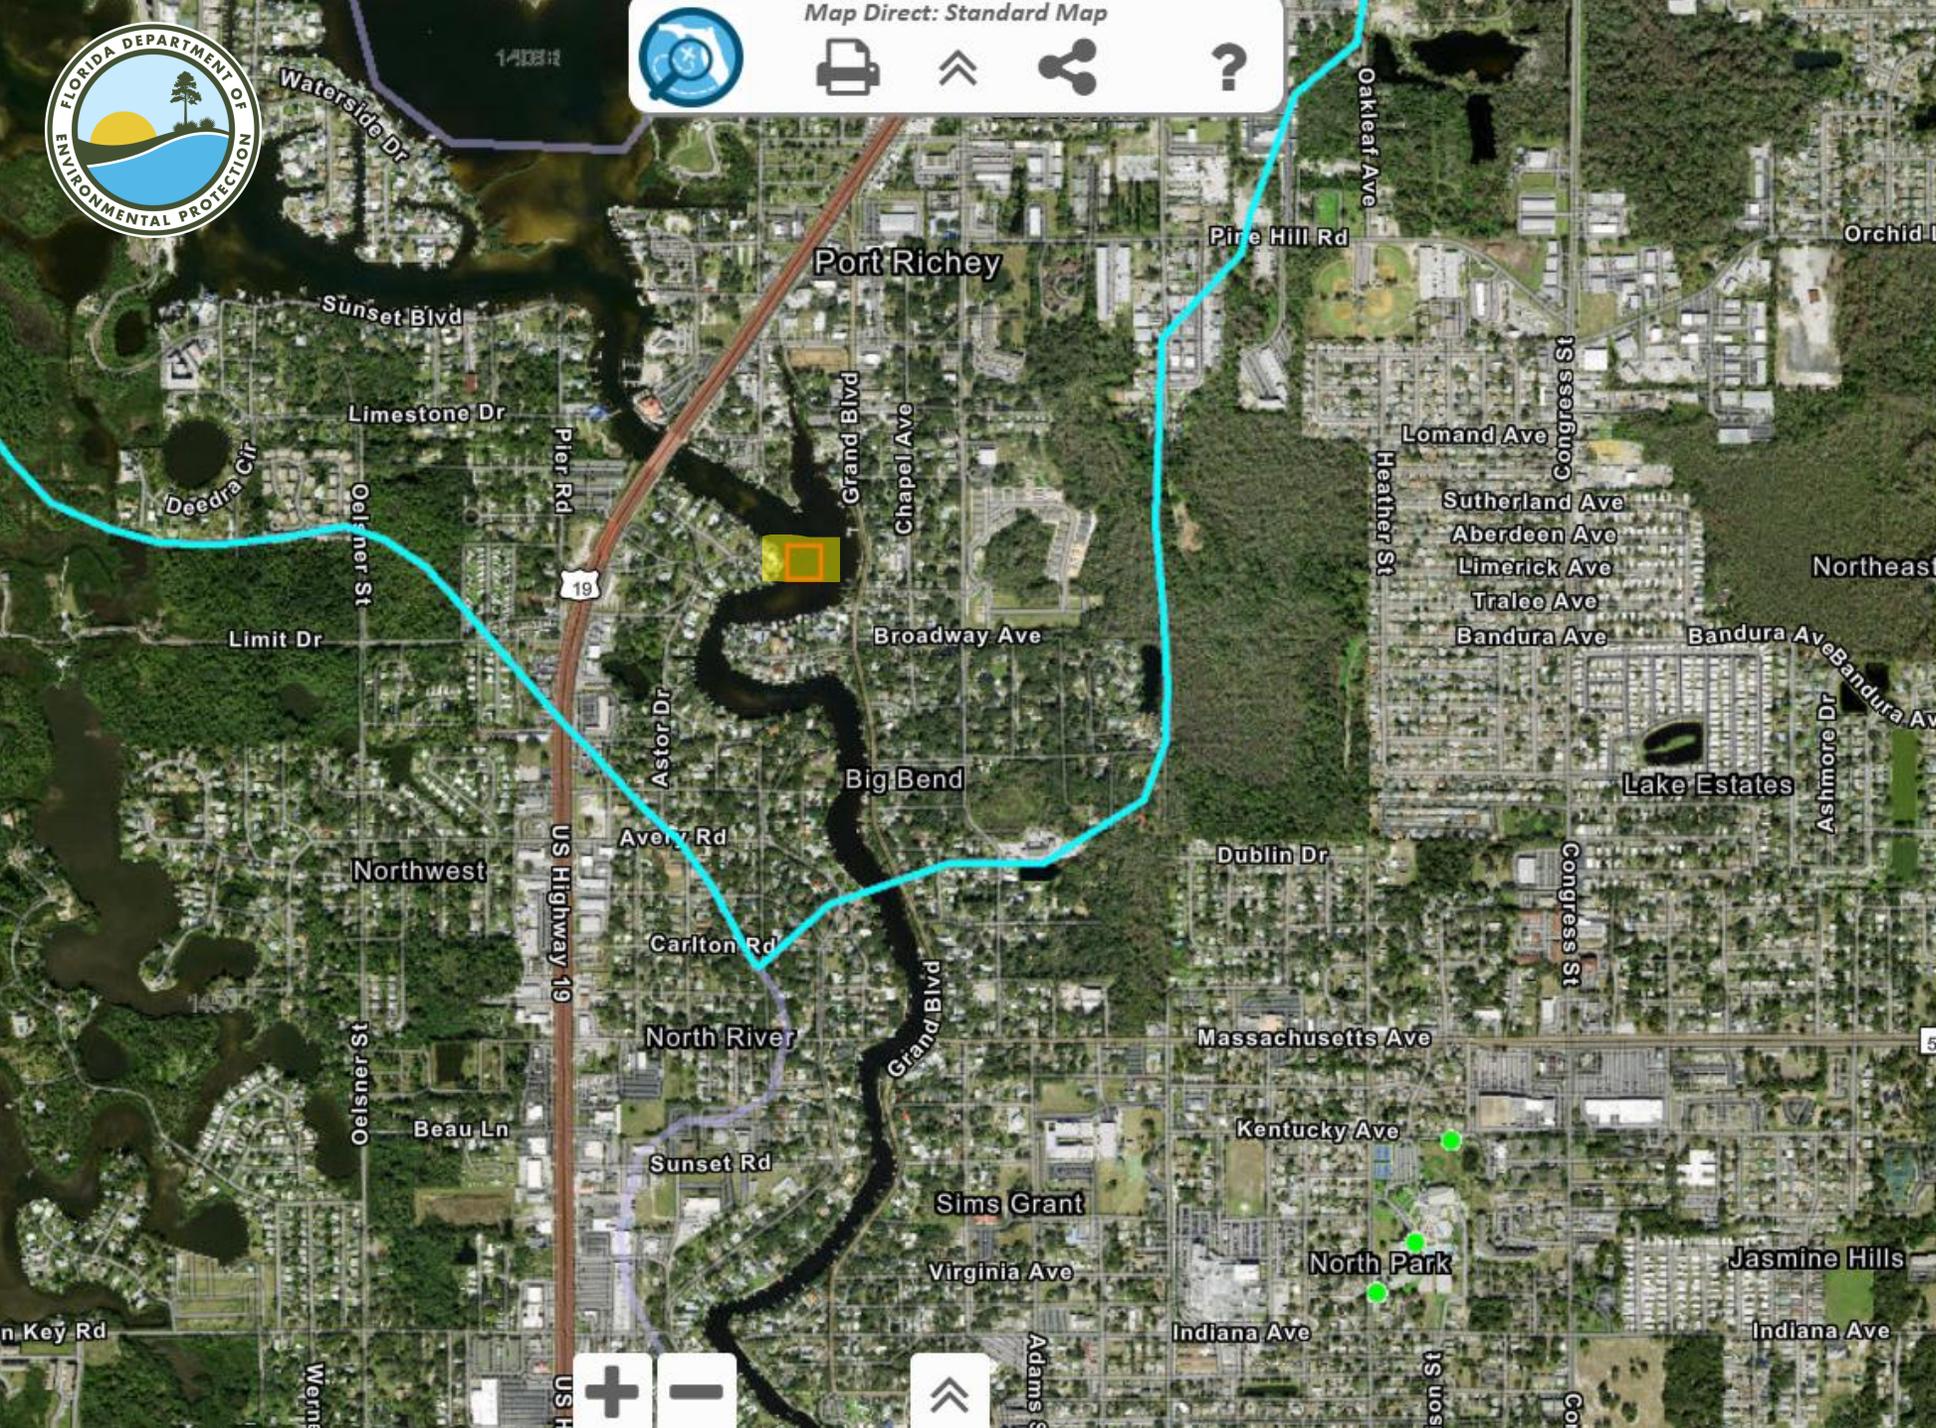

Search Box 251 feet wide at
 28.26736770 x -82.72290796
 28°16'2.5237" x -82°43'22.4687"

Drop Marker Add Label What's nearby


Zoom To this selected feature

Waterbody IDs (WBIDs)

HUC	03100207
WBID	1409Cahaffey Dr
PARENT WBID	
DISTRICT	SWD
PLANNING UNIT	Middle Coastal
GROUP NUMBER	Group 5
GROUP NAME	Springs Coast
WATERBODY NAME	PITHLACHASCOTEE RIVER TIDAL
WATERBODY SIZE	0.37006
UNITS	sq. miles
WATER TYPE	ESTUARY
CLASS	3M
CHANGES	
EDITS	WBID modified, Run 39 - J.Espy
DEP.WBIDS.SP.AREA	0 usetts Ave
PERIMETER	9991.140877
OBJECTID	4175

28.25856050 x -82.71209329
 28°15'30.8178" x -82°42'43.5359"

--Show County--

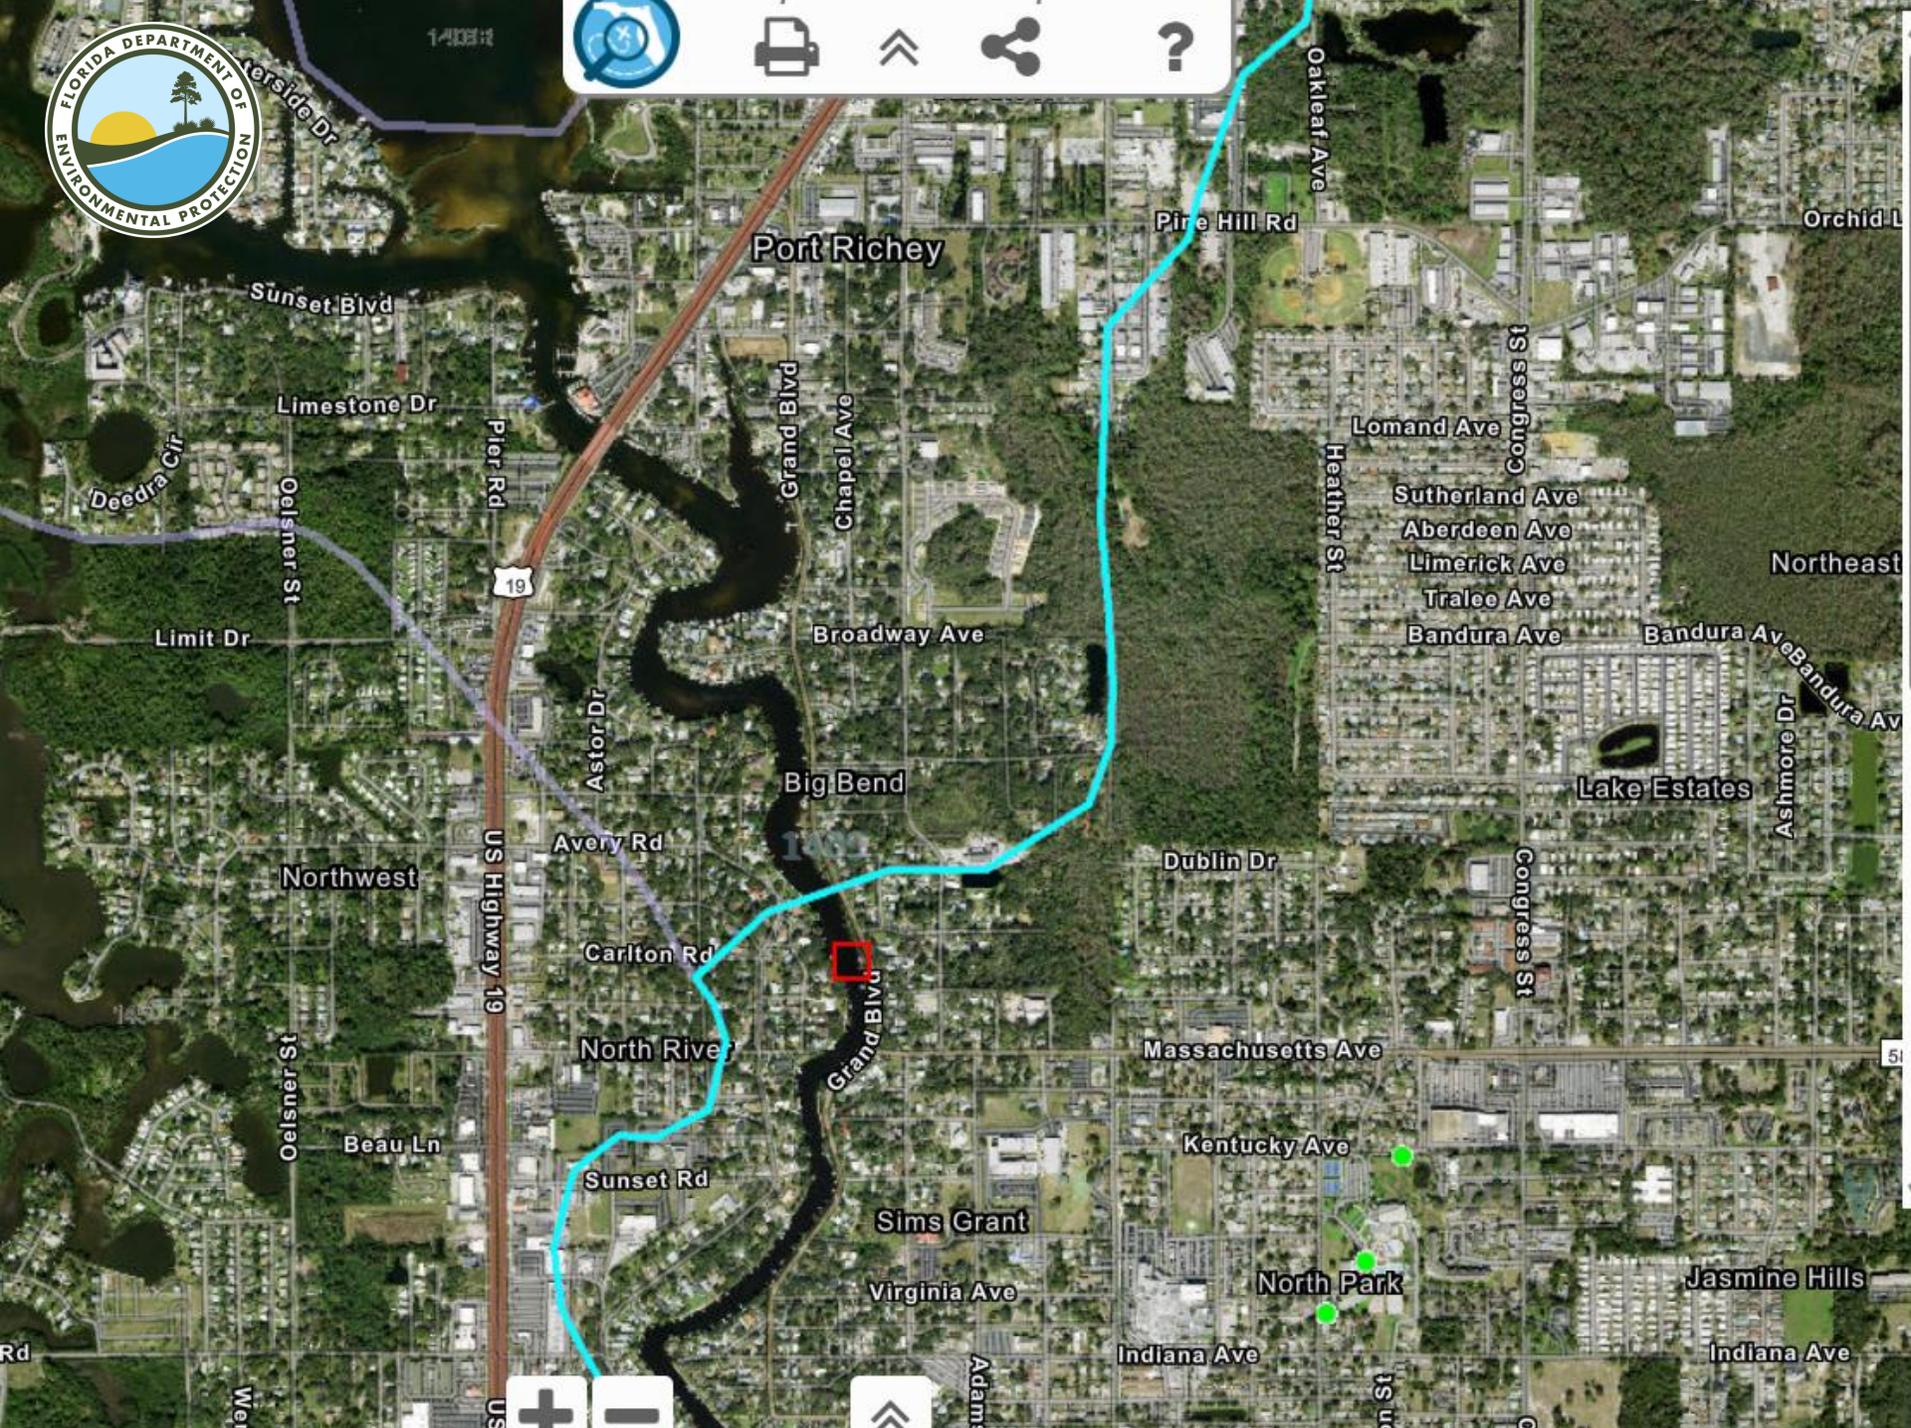

Search Box 251 feet wide at
 28.26029932 x -82.72071928
 28°15'37.0776" x -82°43'14.5894"

Drop Marker Add Label What's nearby?

Zoom To this selected feature Clear Print Table Download Format

Waterbody IDs (WBIDs)

HUC	03100207
WBID	1409
PARENT WBID	
DISTRICT	SWD
PLANNING UNIT	Middle Coastal
GROUP NUMBER	Group 5
GROUP NAME	Springs Coast
WATERBODY NAME	PITLACHASCOTEE RIVER
WATERBODY SIZE	21.878
UNITS	miles/valley
WATER TYPE	STREAM
CLASS	3F
CHANGES	
EDITS	WBID modified, Run 57 - B.Spencer
DERWBIDS SPAREA	0
PERIMETER	108821.464082
OBJECTID	4172

--Show County--

28.26071512 x -82.73119062



Map Direct: Standard Map

fla2903

Alturas Babson Park Cutoff Rd

Alturas Babson Park Cutoff Rd

Lake Buffum Rd

e Hill Ct

Field Way

-  **JMC Ranch RAF**
FACILITY NAME
-  **1323**
LOCATIONAL ID
-  **29038**
WAFR FACILITY ID
-  **FLA290386**
FACILITY ID
-  <https://prodenv.dep.state.fl.us/DepNexus/p/documents/FLA290386/gis-facility!search>
DOCUMENTS
-  **(53) Polk County**
COUNTY
-  **Polk County**
COUNTY NAME
-  **(Southwest District) Southwest District**
OFFICE NAME
-  **(SWD) Southwest Regulatory District**
DISTRICT NAME
-  **N**
NPDES
-  **N**
PRETREAT REQ.
-  **DPHO**
CMCD COORDINATE METHOD ID
-  **Domestic Wastewater Program**
ENVIRONMENTAL INTEREST
-  **A**
FACILITY STATUS
-  **RAF**
FACILITY TYPE
-  **Wastewater Residuals Application Site**
MANAGED ENTITY TYPE




--Show County--

27.82053258 x -81.60852707
27°49'13.9173" x -81°36'30.6975"





Common Deficiencies Noted

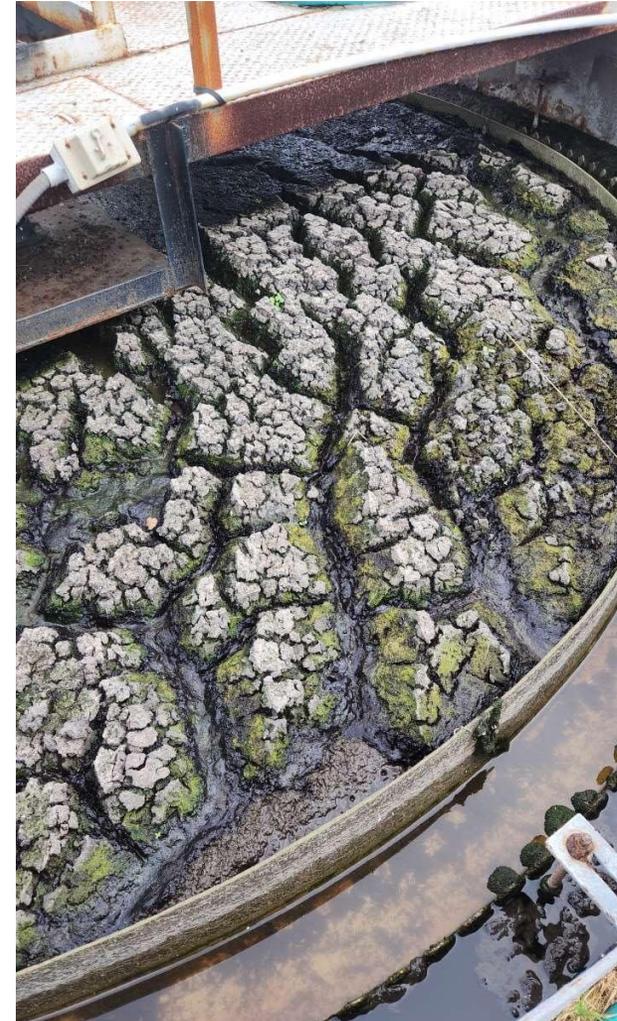



Common Deficiencies Noted






Common Deficiencies Noted





Common Deficiencies Noted

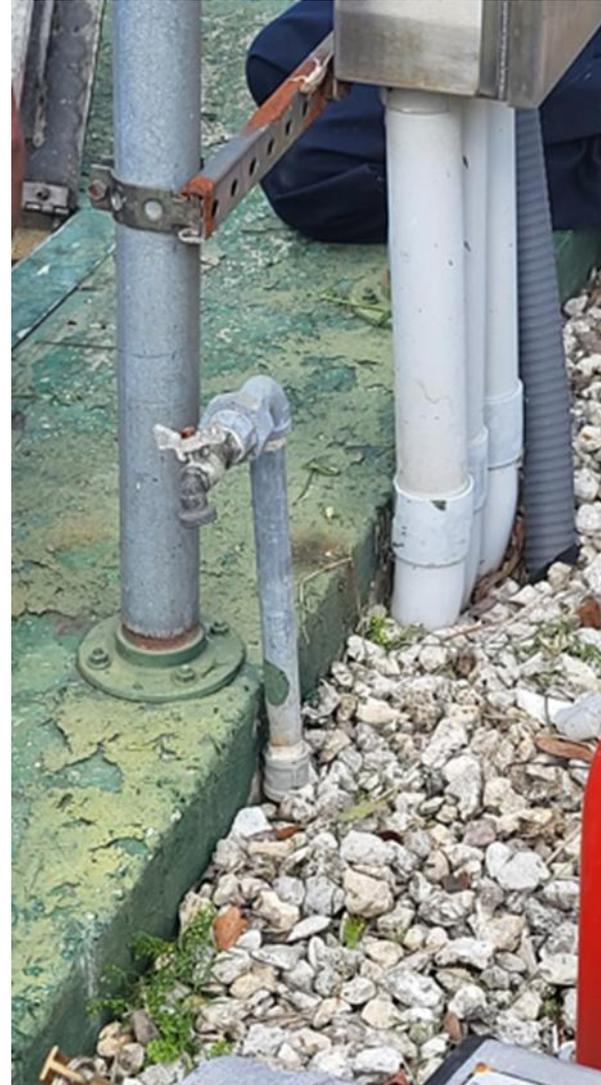



SWD Contact Information

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

Environmental Manager – Emily Larson

- Phone: (813) 470- 5955
- Email: Emily.Larson@FloridaDEP.gov

Environmental Consultant – Erica Peck

- Phone: (813) 470- 5906
- Email: Erica.Peck@FloridaDEP.gov



Inspector Contact Information

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

➤ **Jessie Standridge**

➤ **Phone: (813) 470-5736**

➤ **Email: Jessie.Standridge@FloridaDEP.gov**

➤ **Hannah Teague**

➤ **Phone: (813) 470-5727**

➤ **Email: Hannah.Teague@FloridaDEP.gov**

➤ **Maryn Tidwell**

➤ **Phone: (813) 470-5919**

➤ **Email: Maryn.Tidwell@FloridaDEP.gov**

➤ **Anthony Disipio**

➤ **Phone: (813) 470-5860**

➤ **Email: Anthony.Disipio@FloridaDEP.gov**



Inspector Contact Information

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

➤ Lauren Ballard

➤ Phone: (813) 470-5784

➤ Email: Lauren.Ballard@FloridaDEP.gov

➤ Grace Parker

➤ Phone: 813) 470-5900

➤ Email: Grace.O.Parker@FloridaDEP.gov

➤ Emmalise Hunter

➤ Phone: (813) 470-5787

➤ Email: Emmalise.C.Hunter@FloridaDEP.gov

➤ Alexandra Myers

➤ Phone: (813) 470-5751

➤ Email: Alexandra.Myers@FloridaDEP.gov

➤ Lauren Squires

➤ Phone: (813) 470-5937

➤ Email: Lauren.Squires@FloridaDEP.gov



SWD Contact Information

Site - near I-75/Fletcher Ave.
Southwest District Office

Telecom Park

13051 N. Telecom Parkway, Suite 101

Temple Terrace, FL 33637

(813) 470-5700

(813) 470-5995 FAX



General Contact Information

- **DEP SWD (813) 470-5700**
 - <https://floridadep.gov/southwest/>
- **FRWA (850) 668-2746**
 - www.frwa.net
- **EPA (800) 423-4791**
 - www.epa.gov
- **Florida State Watch Office**
1 (800) 320-0519
 - www.floridadisaster.org



Questions?